


# **SUPPLY AIR FILTER AND RETURN AIR DUCT SMOKE DETECTION SYSTEM**

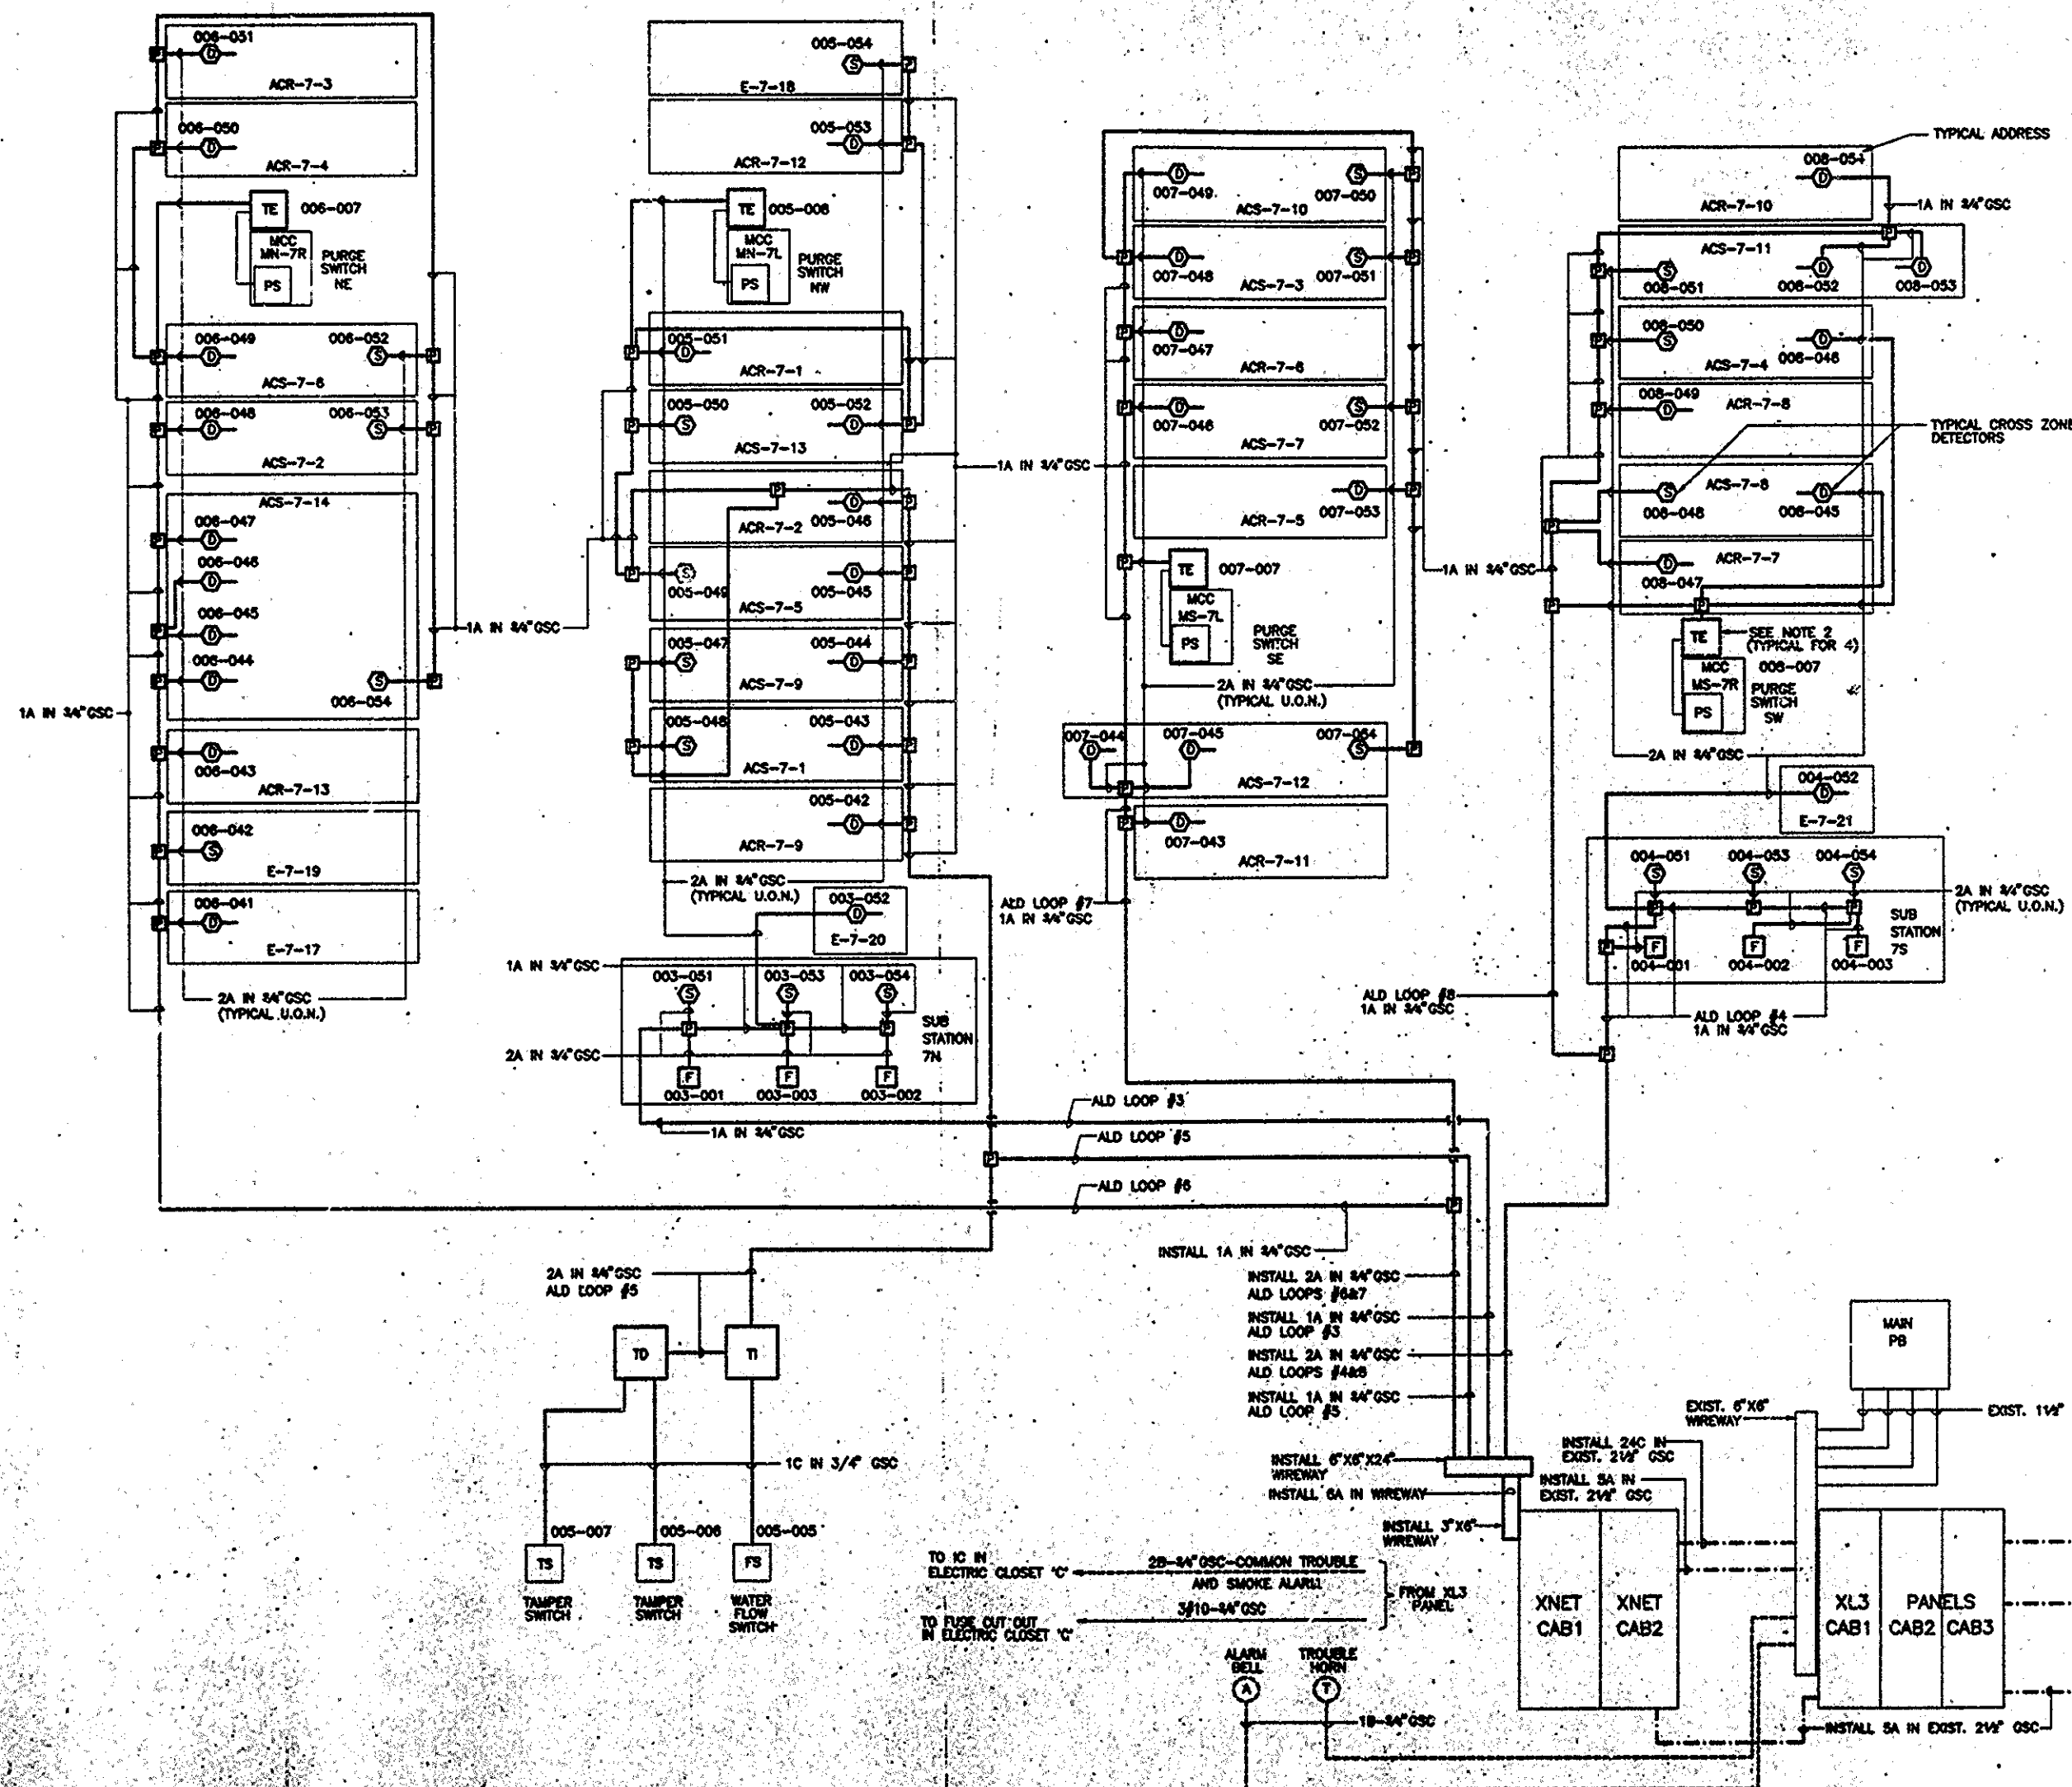

## **NOTES:**

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRX AND E.O.L. FROM EXIST. BOX LOCATED ABOVE MOC AND INSTALL TRX-88 AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 7th FLOOR MER PLAN, SEE DWG E-7.
4. FOR 7th FLOOR MER REMOVAL PLAN, SEE DWG E-8.

Sheet 2 of 58

**THE PORT AUTHORITY  
OF NY & NJ**

*[Signature]*  
ENGINEERING PROGRAM MANAGER  
CHIEF ELECTRICAL ENGINEER

No. Date Revision Approved

Engineering Department  
Design Division

**The World Trade  
Center**

Title  
**FIRE ALARM SYSTEM  
PHASE II  
XL3 CONVERSION  
ELECTRICAL  
1 WTC  
7th FLOOR MER  
FIRE ALARM SYSTEM  
RISER DIAGRAM**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

ROYZMAN  
FELDMAN  
Designed by Drawn by Checked by

Date 5-20-99 Scale NONE  
Contract Number Drawing Number

WTC-881032 E-8

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. 000-000-000-000 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/1/00 *[Signature]*  
DATE 2/1/00 *[Signature]*  
CONTRACT ENGINEER  
ENGINEERING PROGRAM MGR